


SECTION

NOTES


1. DRIVEWAYS SHALL INCLUDE DOWELED EXPANSION JOINTS AT 20' SPACING AND CONTROL BREAK JOINTS AT 10' SPACING.
2. PROVIDE 18" OVERLAP (MIN) ON REINFORCING.
3. 5 1/2 SACK (3,500 PSI) CONCRETE.
4. EXPANSION JOINTS SHALL HAVE SEALANT.
5. SIDEWALKS SHALL MATCH THICKNESS OF DRIVEWAYS IN CONFINES OF DRIVEWAY WIDTH.
6. DRIVEWAY MINIMUM THICKNESS FOR RESIDENTIAL IS 6".
7. DRIVEWAY MINIMUM THICKNESS FOR COMMERCIAL IS 7" OR AS CALLED IN PLANS.

TIE 1/2" (#4) DOWEL TO DRIVEWAY REBAR AND DRILL/EXPOXY 6" (MIN) INTO EXIST CONC. ROAD


RAF
 6/6/23



CITY OF SANTA FE	
CONCRETE DRIVEWAY REPLACEMENT ON EXISTING CONCRETE ROAD w/6" CURB	
	13430 NW Freeway Suite 700 Houston, Tx. 77040 713.462.3178 <small>TxEng Firm 2728 TxSurv Firm 10110700</small>
	DATE: 06/05/23 DRAWN BY: RAF DESIGNED BY: RAF
IDS JOB No. 2424-002-00	

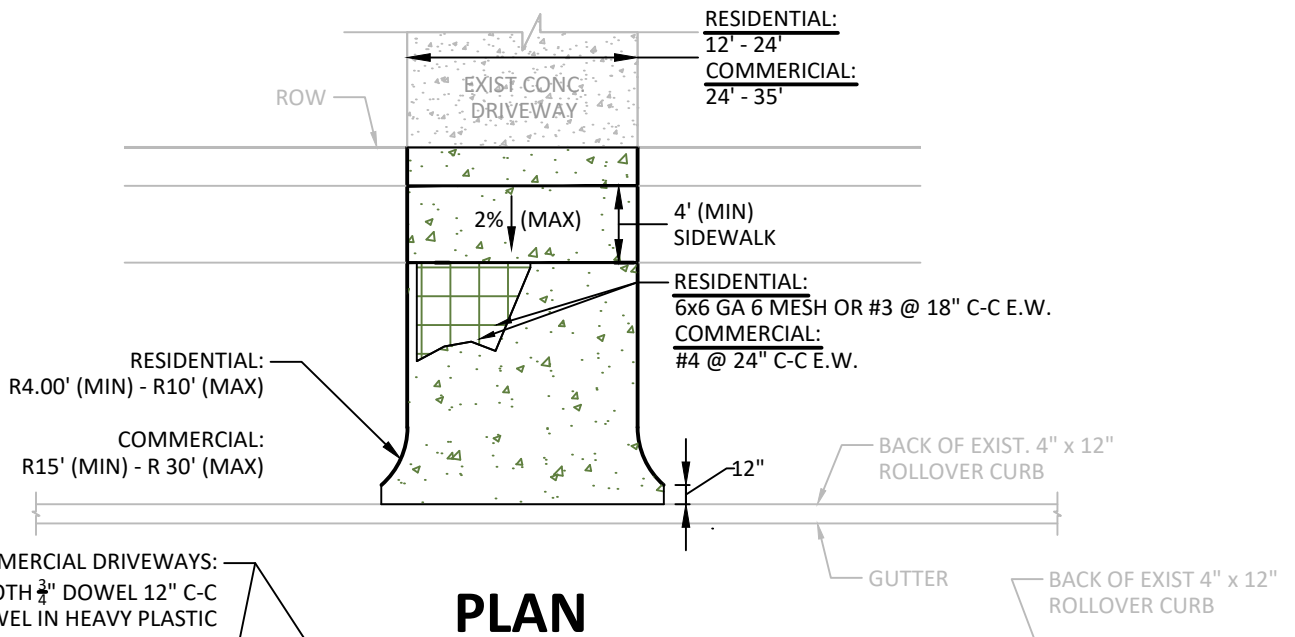

PLAN

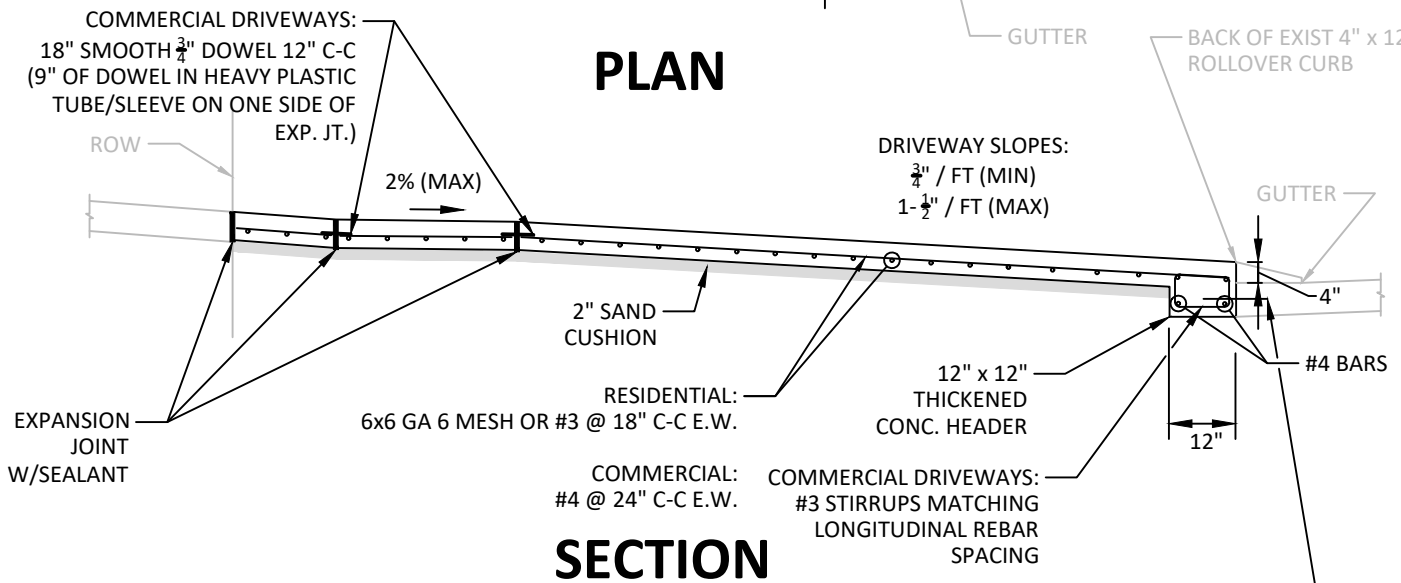


SECTION


NOTES

1. DRIVEWAYS SHALL INCLUDE DOWELED EXPANSION JOINTS AT 20' SPACING AND CONTROL BREAK JOINTS AT 10' SPACING.
2. PROVIDE 18" OVERLAP (MIN) ON REINFORCING.
3. 5 1/2 SACK (3,500 PSI) CONCRETE.
4. EXPANSION JOINTS SHALL HAVE SEALANT.
5. SIDEWALKS SHALL MATCH THICKNESS OF DRIVEWAYS IN CONFINES OF DRIVEWAY WIDTH.
6. DRIVEWAY MINIMUM THICKNESS FOR RESIDENTIAL IS 6".
7. DRIVEWAY MINIMUM THICKNESS FOR COMMERCIAL IS 7" OR AS CALLED IN PLANS.


TIE 1/2" (#4) DOWEL TO DRIVEWAY REBAR AND DRILL/EXPOXY 6" (MIN) INTO EXIST CONG. ROAD

RAF
6/6/23




CITY OF SANTA FE	
CONCRETE DRIVEWAY REPLACEMENT ON EXISTING CONCRETE ROAD w/4"x12" CURB	
	DATE: 06/05/23 DRAWN BY: RAF
IDS JOB No. 2424-002-00	DESIGNED BY: RAF

13430 NW Freeway
Suite 700
Houston, Tx. 77040
713.462.3178
TxEng Firm 2728
TxSurv Firm 10110700

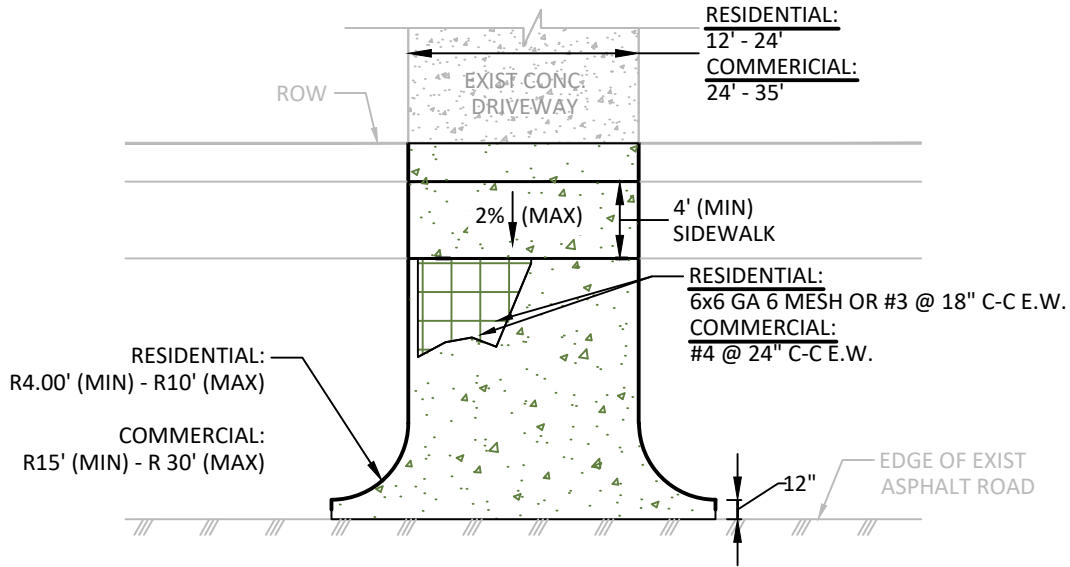

PLAN

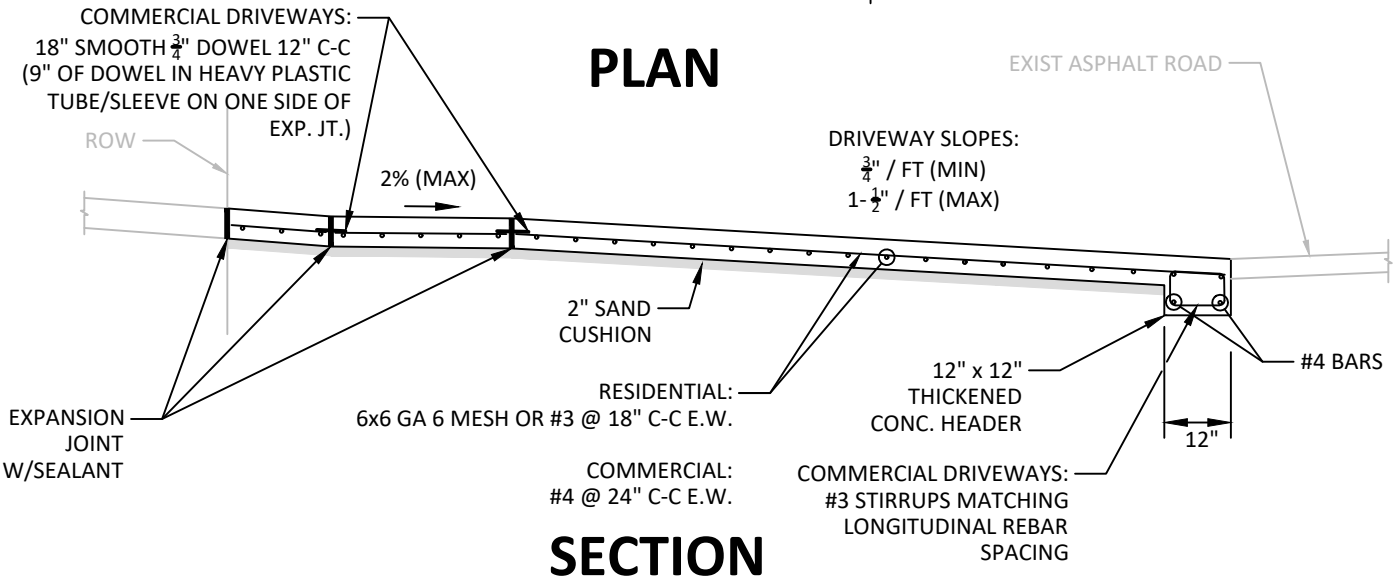



SECTION

NOTES

1. DRIVEWAYS SHALL INCLUDE DOWELED EXPANSION JOINTS AT 20' SPACING AND CONTROL BREAK JOINTS AT 10' SPACING.
2. PROVIDE 18" OVERLAP (MIN) ON REINFORCING.
3. 5 1/2 SACK (3,500 PSI) CONCRETE.
4. EXPANSION JOINTS SHALL HAVE SEALANT.
5. SIDEWALKS SHALL MATCH THICKNESS OF DRIVEWAYS IN CONFINES OF DRIVEWAY WIDTH.
6. DRIVEWAY MINIMUM THICKNESS FOR RESIDENTIAL IS 6".
7. DRIVEWAY MINIMUM THICKNESS FOR COMMERCIAL IS 7" OR AS CALLED IN PLANS.

RAF
6/6/23



CITY OF SANTA FE	
CONCRETE DRIVEWAY REPLACEMENT ON EXISTING ASPHALT ROAD	
	13430 NW Freeway Suite 700 Houston, Tx. 77040 713.462.3178 <small>TxEng Firm 2728 TxSurv Firm 10110700</small>
IDS JOB No. 2424-002-00	DATE: 06/05/23 DRAWN BY: RAF DESIGNED BY: RAF